


STORMWATER POST-CONSTRUCTION TREATMENT DEVICE OPERATIONS & MAINTENANCE

Oak Park Biofiltration Vaults

Devices On-Site:
Five (5) Biofiltration Vaults

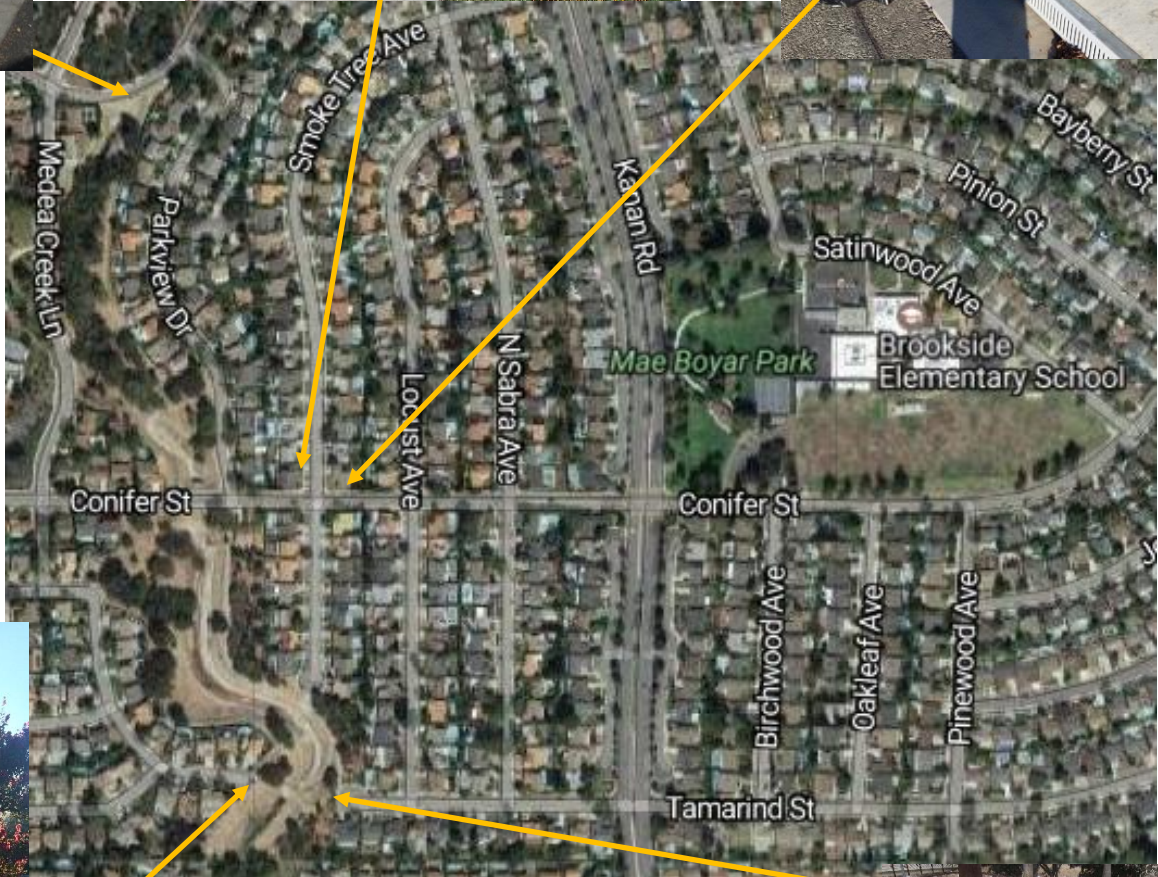

Operations & Maintenance Plan

Date: _____

O & M Personnel: _____

Signature: _____

O & M Frequency: Pre-Wet Season (before Oct 1) Post-Wet Season (after April 15) After Storm

Biofiltration Vaults			
Activity	O & M Needed	O & M Completed	Comments / Maintenance Performed
Remove Trash/Debris/Sediment			
Assess for Poor Vegetative Health (i.e. tree death, odor)			
Repair and Clear Blockages of Inlet/Overflow Pipes			
If Standing Water is present 4 days after rain event, maintenance is needed immediately to restore filtration. This may require replacement of mulch, specialized media, filter fabrics and aggregate.			

*Tamarind St vault and two at Conifer and Smoke Tree have specialized media consisting of GAC, Zeolite and Anthracite.